

FIRE COMPANY CERTIFICATION:	
NAME & TITLE	
NATURAL RESOURCES CONSERVATION SERVICE CERTIFICATION:	
NAME & TITLE	
FREEZE PROTECTION	
10" PWC FROM HEAD ASSY TO BELOW NORMAL WATER: ANNUAL SPACE FILLED WITH INSULATION FOAM. (PREXANDOLU OR EXPANDING FOAM)	YES -- NO --
GUARDED POSTS - SEE NOTE #1	
YES -- NO --	

NOTES:



1. GUARD POSTS, IF REQUIRED, SHALL BE \_\_\_\_\_

2. ANCHORS SHALL BE \_\_\_\_\_

\_\_\_\_\_

\_\_\_\_\_

<u>BILL OF MATERIALS</u>					
<u>ITEM</u>	<u>MASK</u>	<u>QUAN.</u>	<u>UNIT</u>		
6" HYDRANT ASSEMBLY - 90' BAND	1	1	EACH		
HYDRANT CAP	2	1	UN.		
6" STAINLESS STEEL STRAINER	3	—	IN. FT.		
6" SCH. 40 PVC 90° ELBOW	4	1	EACH		
6" SCH. 40 PVC PIPE-RISER	5	—	IN. FT.		
6" SCH. 40 PVC PIPE	6	7	UN. FT.		
6" SCH. 40 PVC COUPLINGS	7	—	EACH		
PRIMER CLEANER	8	1	CAN		
PVC GLUE	9	1	CAN		
PVC - STEEL COUPLING	10	2	EACH		
ANCHOR	11	2	EACH		
6" SCH. 40 PVC 45° ELBOW	12	2	EACH		
R-__ RIP-RAP	13	—	C.Y.		
				G.P.M.	
				G.P.M.	

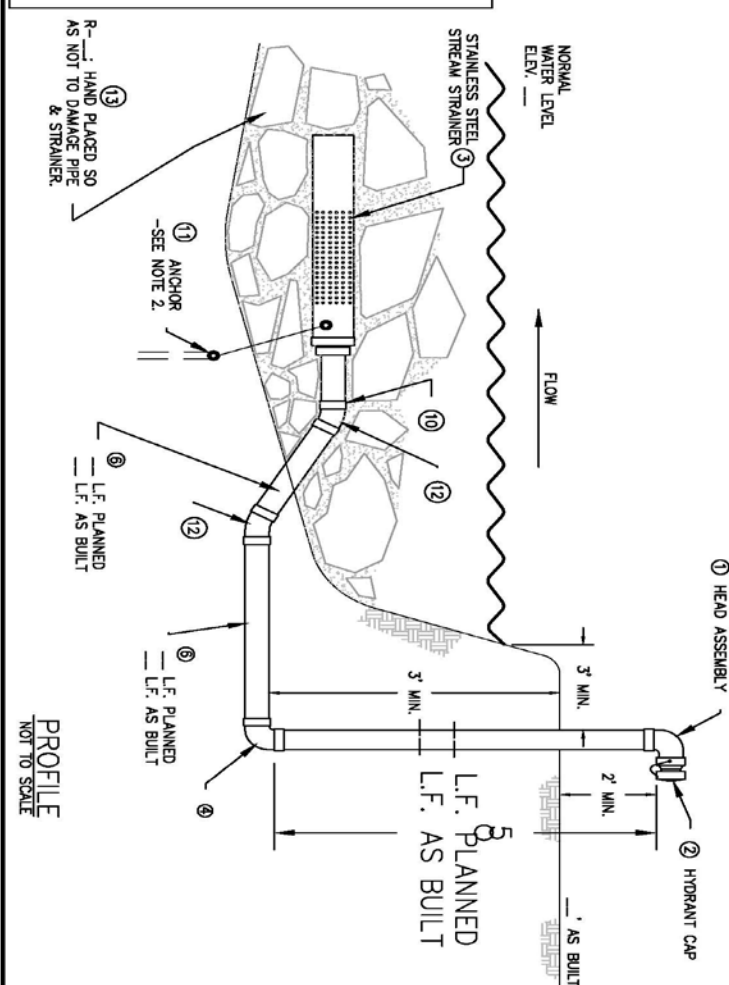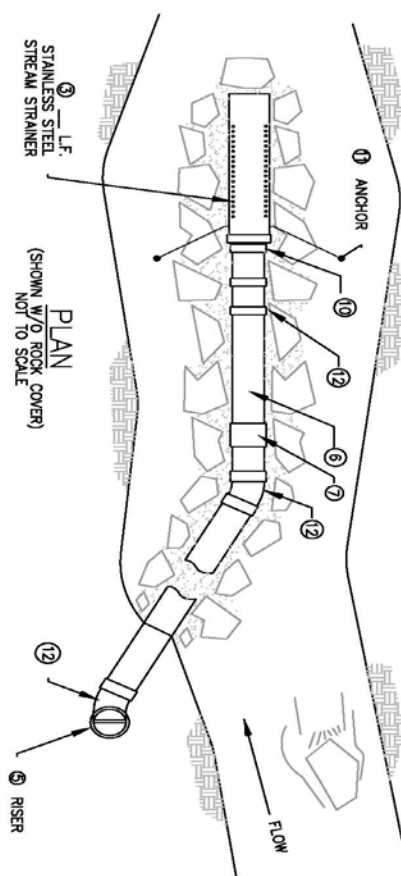

Designated _____	Defect _____
Drawn <u>D. GORDON</u>	_____
Checked _____	_____
Approved by _____	_____

\_\_\_\_\_ COUNTY, PENNSYLVANIA

### 6" DRY HYDRANT SHALLOW STREAM INSTALLATION



File No.	PA-0598
Drawing No.	PA-0598
Sheet _____ of _____	